





**CUSTOMER SUPPLIED POLE MOUNTED  
OVERHEAD METER ASSEMBLY,  
RESIDENTIAL, 200 AMP RATED**  
For Upgraded or Repaired Existing Services Only  
N.A. for New Electric Services

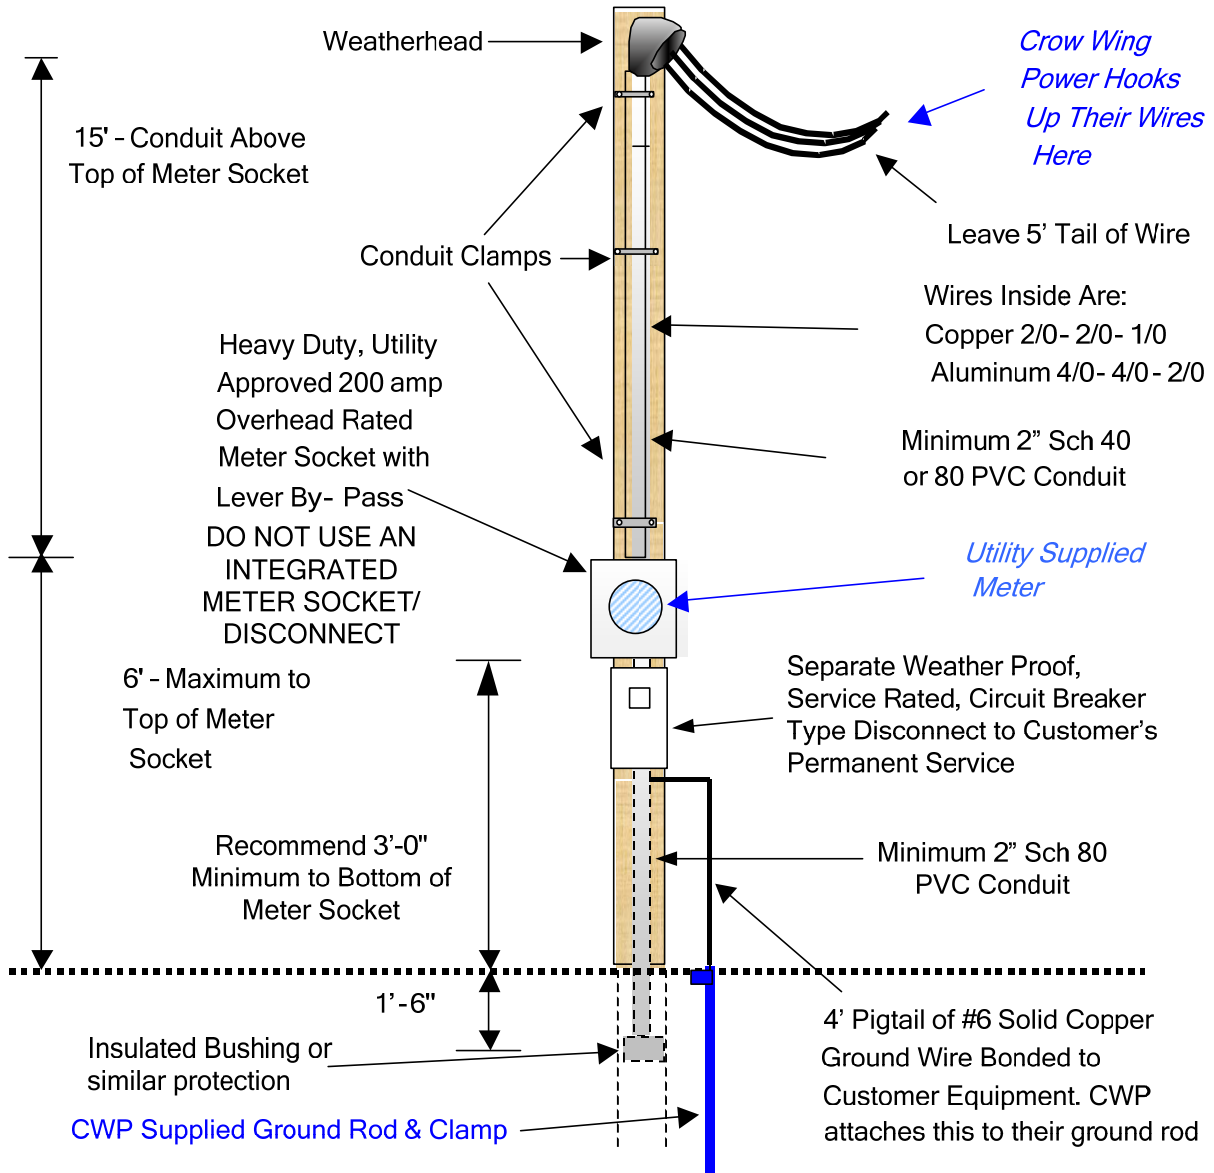

**Notes:**

All meter assemblies must be approved by the Minnesota State Board of Electricity prior to energizing by Crow Wing Power.  
Consult with the State Wiring Inspector **BEFORE** hooking up to a Manufactured or Mobile Home.

## TYPICAL APPLICATIONS

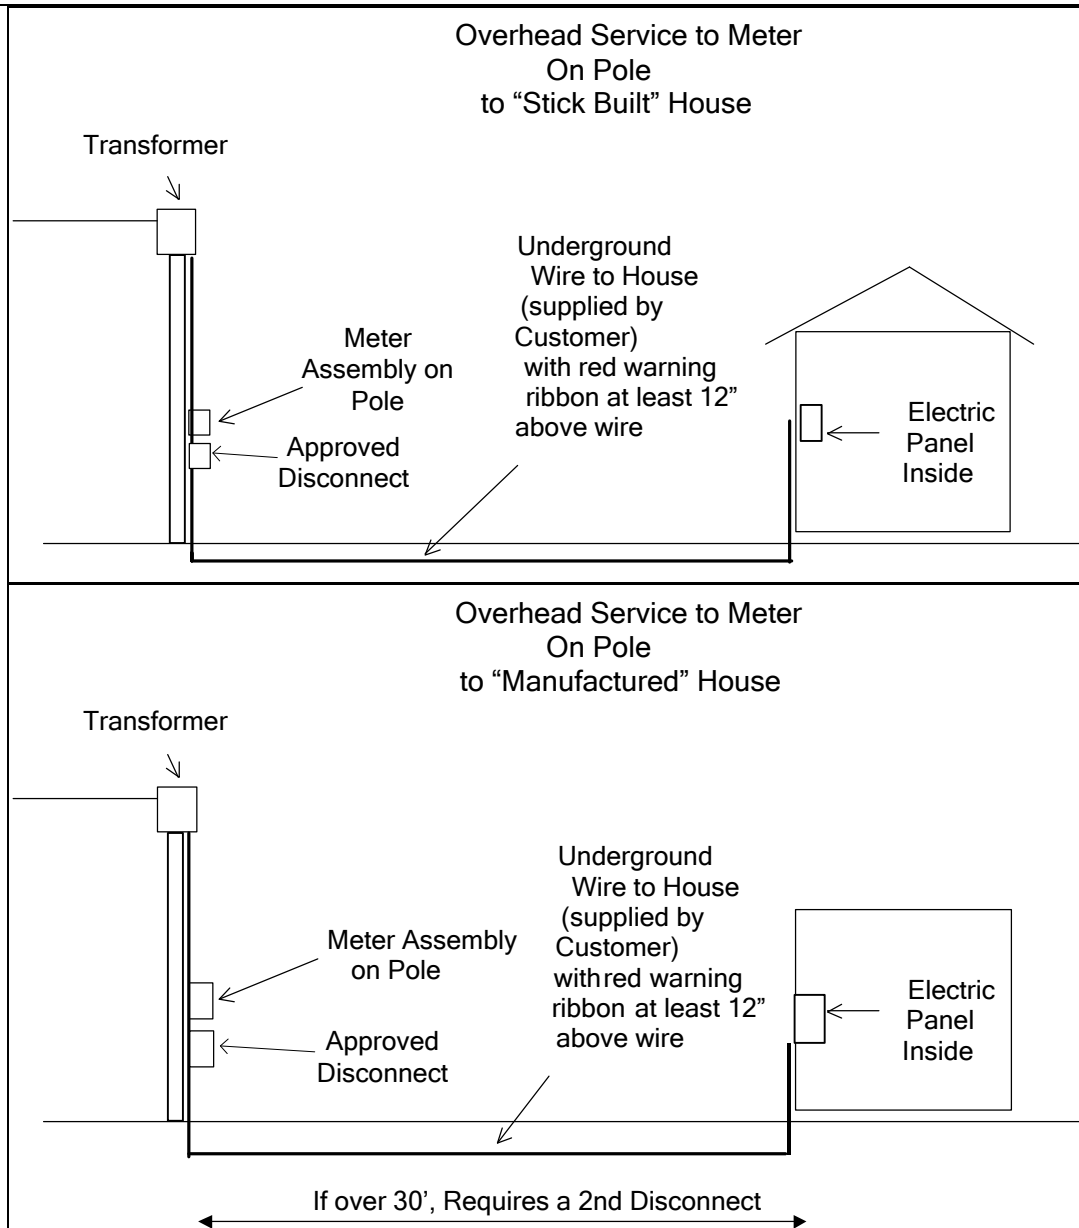

- **PLEASE NOTE:** Applicable to upgraded or repaired existing services ONLY. New Electric Services must utilize Crow Wing Power furnished Meter Assemblies
- Customer supplied wiring from the load side of the meter equipment must be sized in accordance with the National Electric Code.
- An approved disconnect on the load (customer) side of the meter socket is required. Disconnects are separate from (not integrated into) the meter socket.
- Wire size of a residential single phase dwelling service can be sized using the table notes for Article 310:15 (B)(6). This includes a separate, dedicated ground wire.
- Any secondary residential type service for heating or air conditioning (continuous duty service) is not subject to derating and must be sized from table 310:16. This is for both direct and subtractive metering.
- Red warning ribbon is placed at least 12" above underground wiring.